NRO APPROVED FOR RELEASE 10 JUNE 2014

ACOUSTIC TEST FACILITY

WHS-180 pg 11

27' x 38' x 50' I. DIMS.

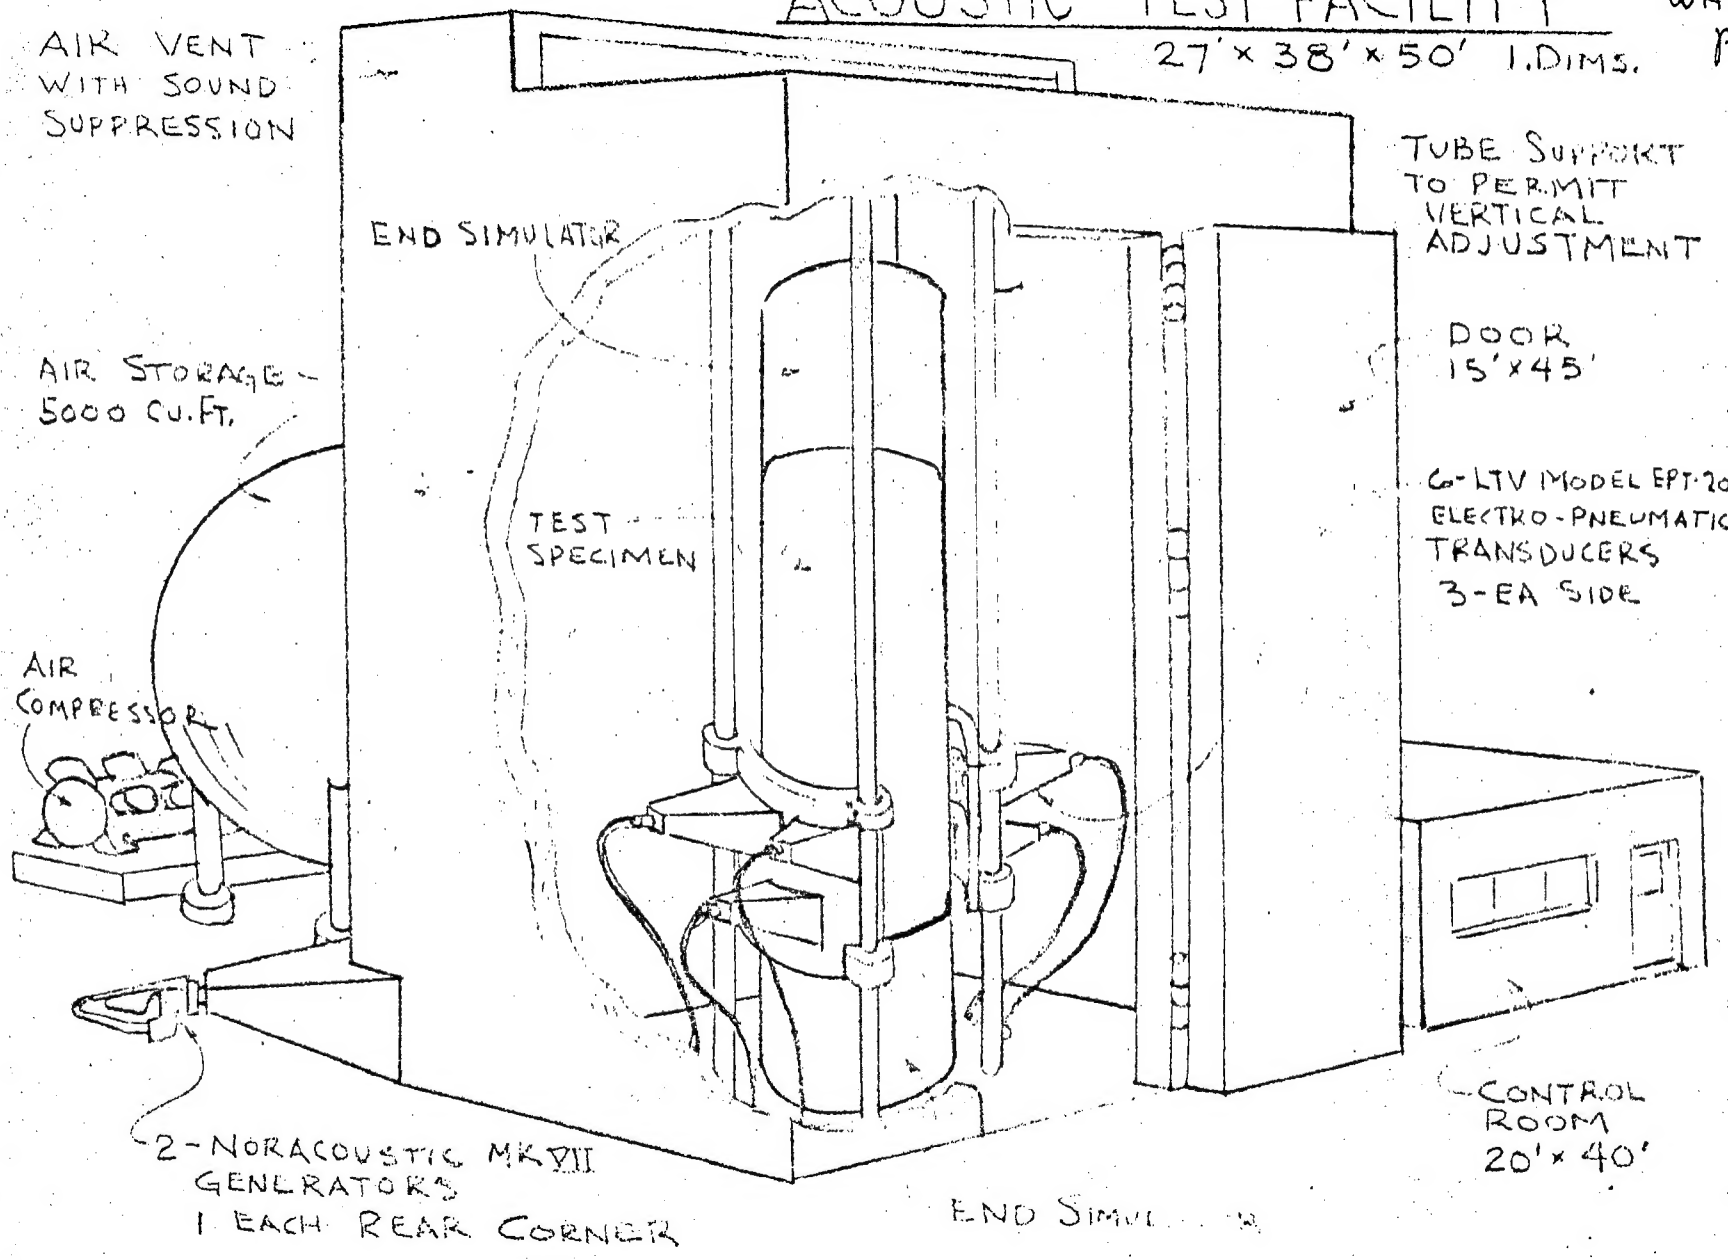
AIR VENT WITH SOUND SUPPRESSION
END SIMULATOR
TUBE SUPPORT TO PERMIT VERTICAL ADJUSTMENT
DOOR 15' x 45'
AIR STORAGE - 5000 CU. FT.
TEST SPECIMEN
6-LTV MODEL EPT-200 ELECTRO-PNEUMATIC TRANSDUCERS 3-EA SIDE
AIR COMPRESSOR
CONTROL ROOM 20' x 40'
2-NORACOUSTIC MK VII GENERATORS 1 EACH REAR CORNER
END SIMUL